


Norris Electric Cooperative

Underground Meter Installation Location Specifications

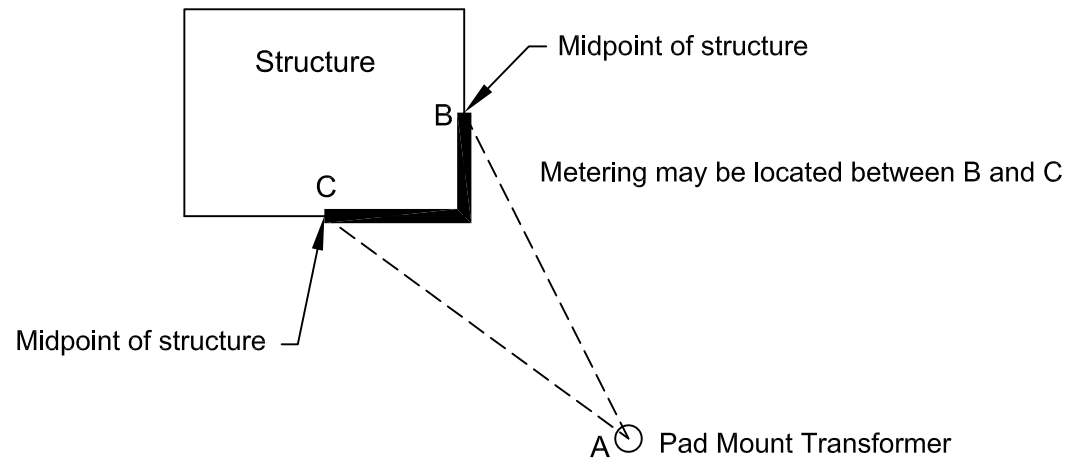

1. When foundation is complete, mark meter location & call Norris engineering department (618-783-8765), duct can be installed before rock drive, other utilities and before house is built.
2. Norris will trench the shortest route between points A and B or A and C with no bends.
3. Metering location shall be located on the side of the structure closest to the transformer.
4. Also see sheets 1 and 2 of Single Phase, 120/240v, 200 AMP ONLY, Underground Meter Installations.