


# Norris Electric Cooperative Boring Specifications

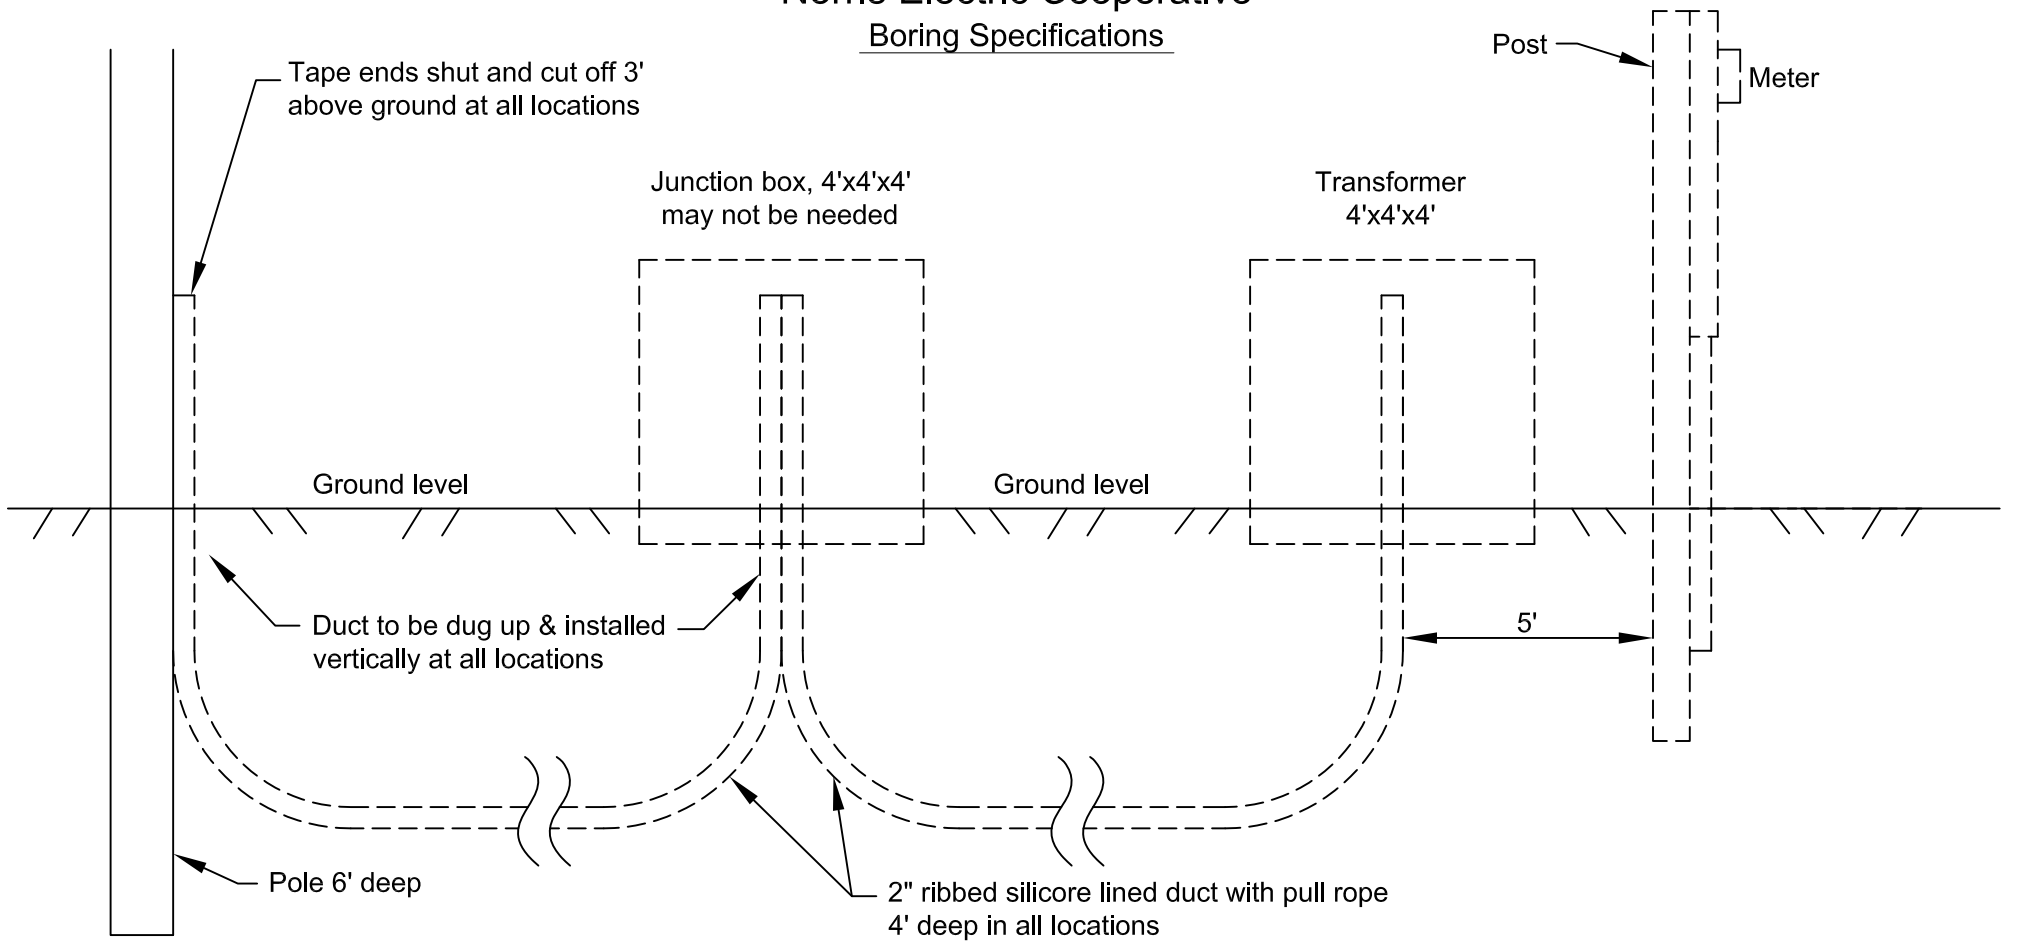

1. Norris to determine bore path, distances, junction box and transformer locations.
2. Norris will cut duct off as needed to install junction boxes and transformers.
3. Meter on post to be installed 5' from riser duct, if meter is farther than 5', duct must be bored in place like duct to transformer.
4. Also see sheets 1 and 2 of Single Phase, 120/240v, 200 AMP ONLY, Underground Meter Installations.
5. Contractor to flag bore when installed.